


INSTRUMENTATION CABLES – MAS SERIES

OVERALL SCREEN - STEEL WIRE ARMoured

MAS5520CSSWA – 20 Pair 1.5mm² TCW CS SWA

APPLICATION: Instrumentation Cable suitable for areas requiring mechanical protection.
Suitable for Direct Burial.

Standards	AS/NZS1125 , AS/NZS3808 , IEC 60332-1-2 , IEC 60332-3-22 , IEC 60079.14 , RoHS Compliant
Conductor	Stranded Tinned Copper Conductor 1.5mm (7/0.50mm)
Insulation	0.4mm PVC ,V90HT , White/Black Numbered Pair's
Screen	Overall Shield of Al/Polyester Foil c/w Tinned Copper Drain Wire (7/0.20mm)
Armour	Galvanized Steel Wire
Sheath	SPVC , 5V-90 , Flame Retardant , UV Resistant Black PVC
Operating Temp.	-20°C to +90°C
Rated Voltage	110VRMS/150VDC
Insulation Voltage Rating	300V
Max. Current Rating	13 Amp
Max. DC Resistance @ 20°C	13.6 Ω/km
Max. Capacitance Cond. To Cond. (Screened)	200 pF/m
Max. Capacitance Cond. To Scr. (Screened)	300 pF/m
Inductance @ 1kHz	0.95 mH/km
L/R Ratio @ 1kHz	36.5 μH/Ω
Insulation Resistance	140 MΩ/km
Bending Radius (Fixed)	10D (D = Cable Diameter)

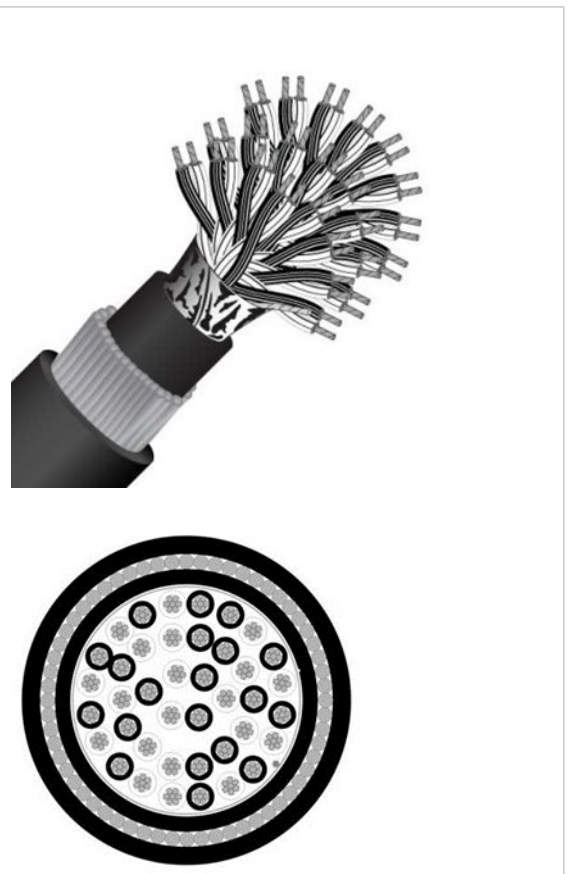

Product	Pairs	Conductor	O.D over Bedding	GSWA Size	O.D over GSWA	Outer Sheath Thickness	Nominal Cable O.D	Cable Weight
Maser Ordering Code	Number of Pairs	mm²	mm	mm	mm	mm	mm	Kg/km
MAS5520CSSWA	20 Pair	1.5mm	21.4	1.6	24.6	2.0	28.6	1779

Jacket Marking

MASER MAS5520CSSWA INSTRUMENTATION CABLE 20PR 1.5mm² TCW/PVC/CS/PVC/SWA/PVC V-90 UV RoHS (MANUFACTURE DATE) (METRE MARK)

Recommended Gland = MM-E1W-32S

Disclaimer: Although Maser Communications NZ Limited makes every reasonable effort to ensure their accuracy at the time of this publication, information and specifications described herein are subject to error or omission and to change without notice. Maser provides the information and specifications herein on an "AS IS" basis, with no representations or warranties, whether express, statutory or implied. In no event will Maser be liable for any damages (including consequential, indirect, incidental, special, punitive, or exemplary damages) whatsoever, even if Maser has been advised of the possibility of such damages, whether in an action under contract, negligence or any other theory, arising out of or in connection with the use, or inability to use, the information or specifications described herein.